




Water^{leaf}


essential to life


Martin Payne

Professional Electrical Engineer
Currently studying towards a Master of Health Science (Environmental Health)
Actively involved in urban Wellington stream restoration

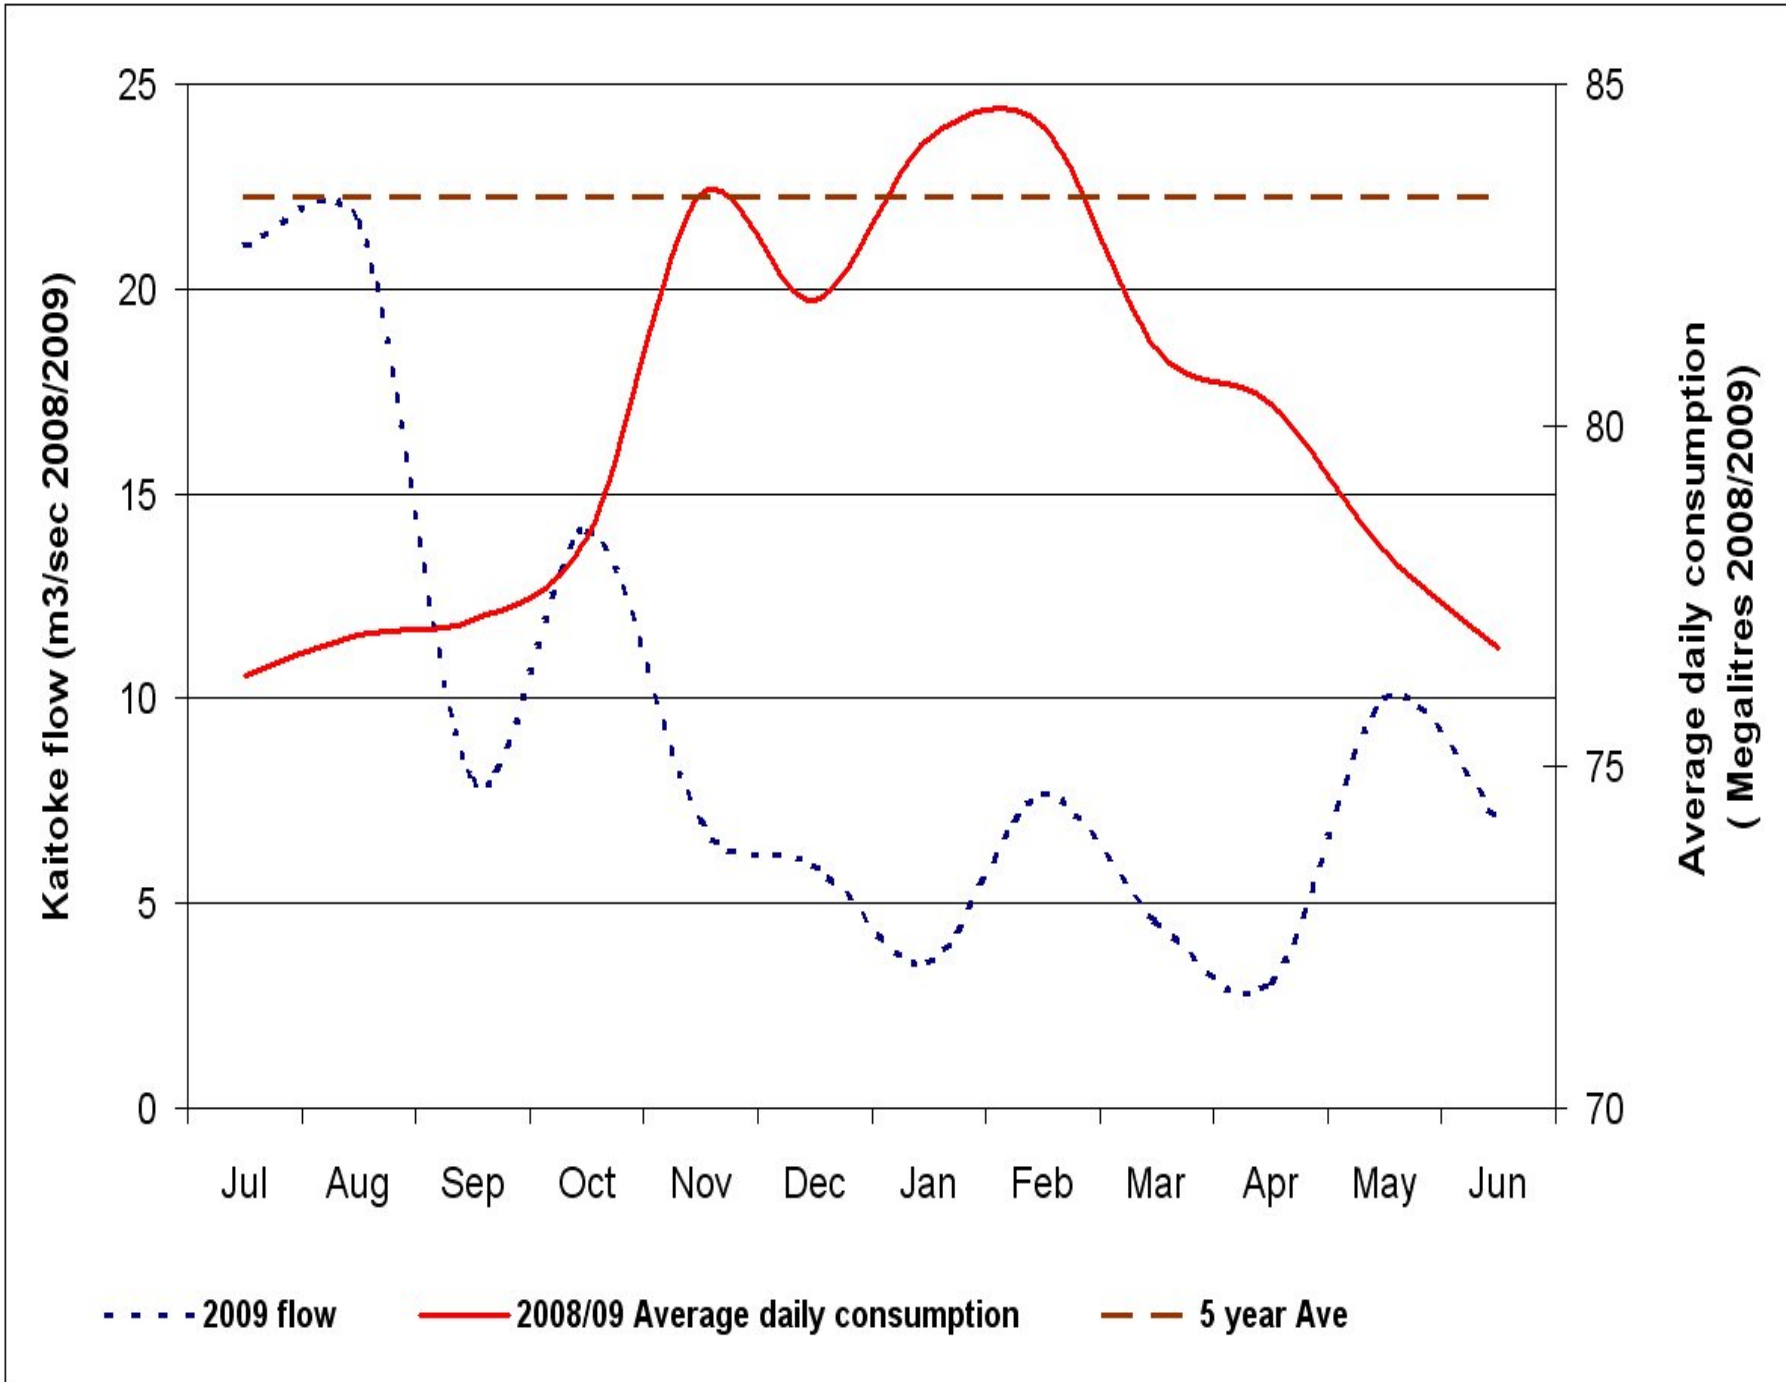

From WCC Report "Water Supply and Demand in Wellington and A Draft Water Efficiency and Conservation Plan" - Graph 5 Page 9

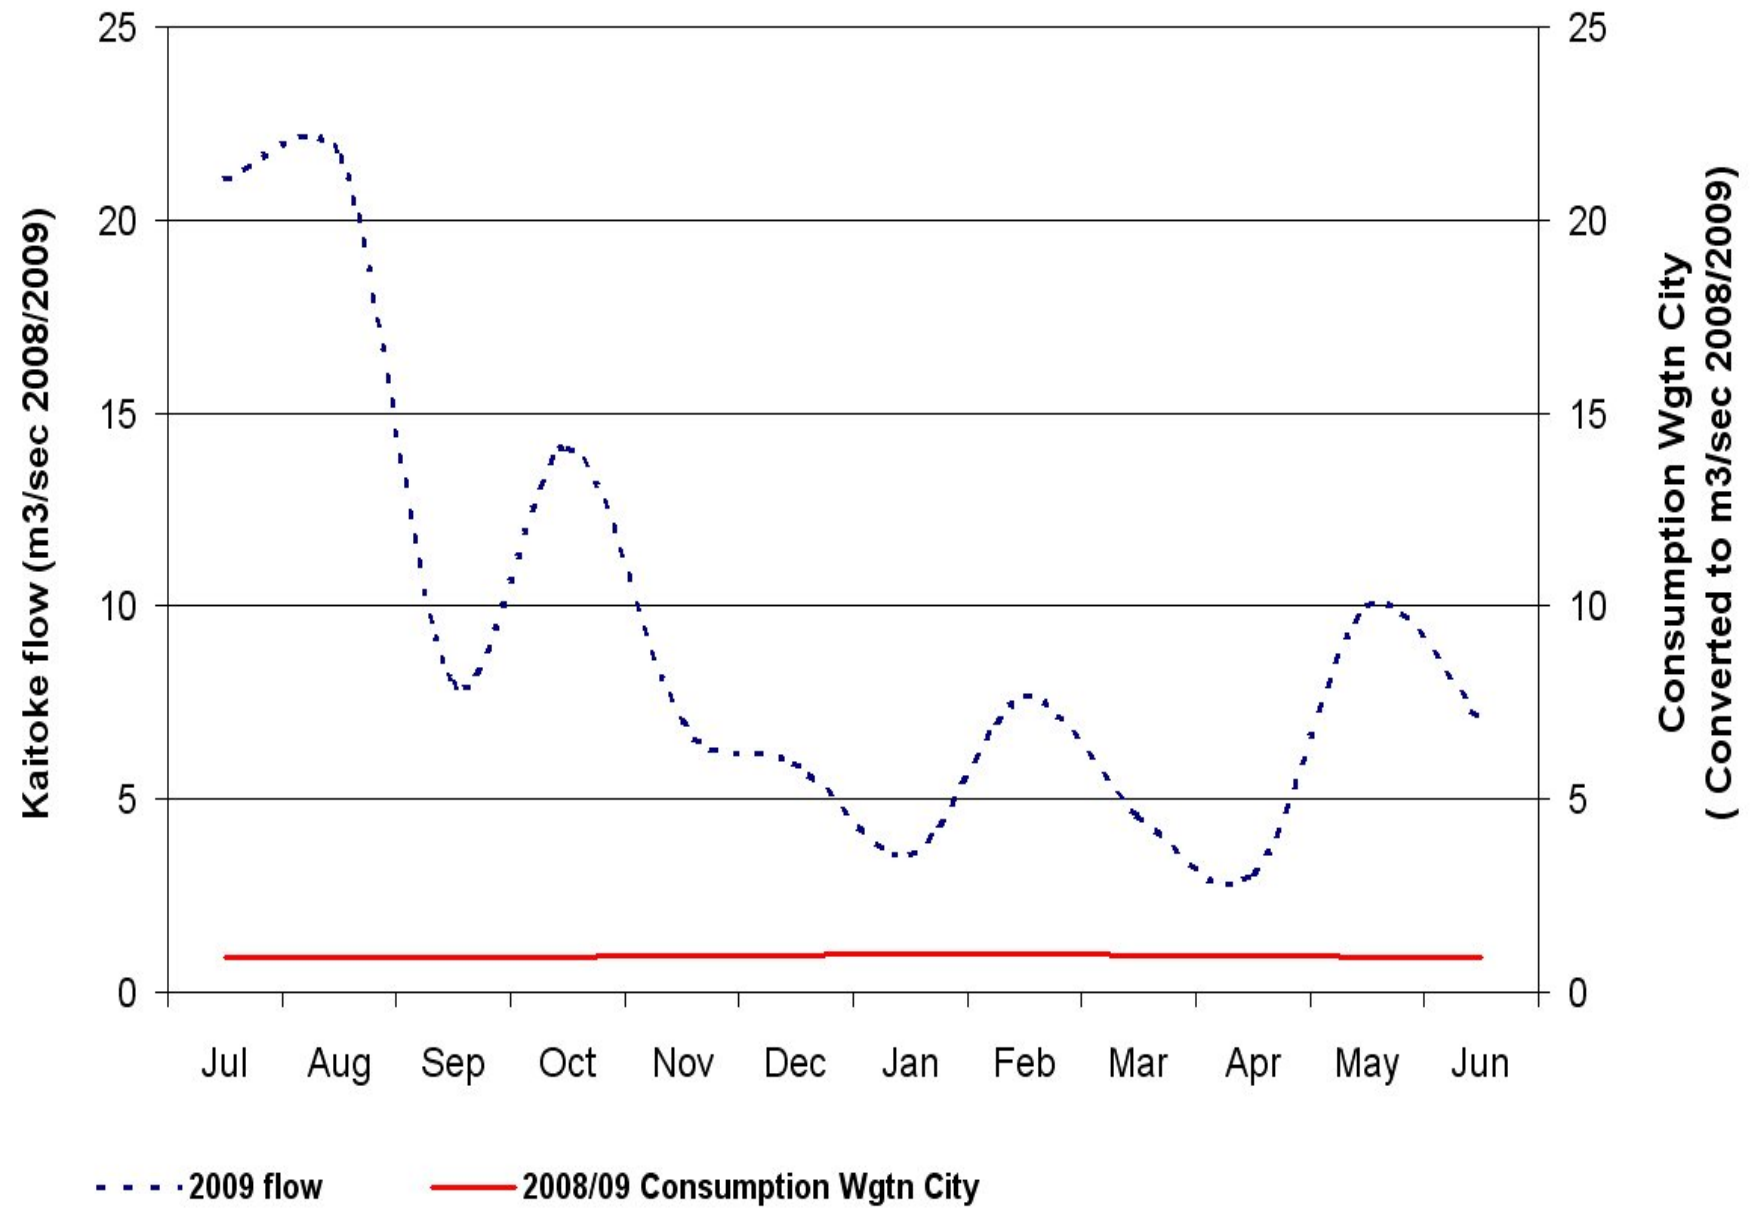

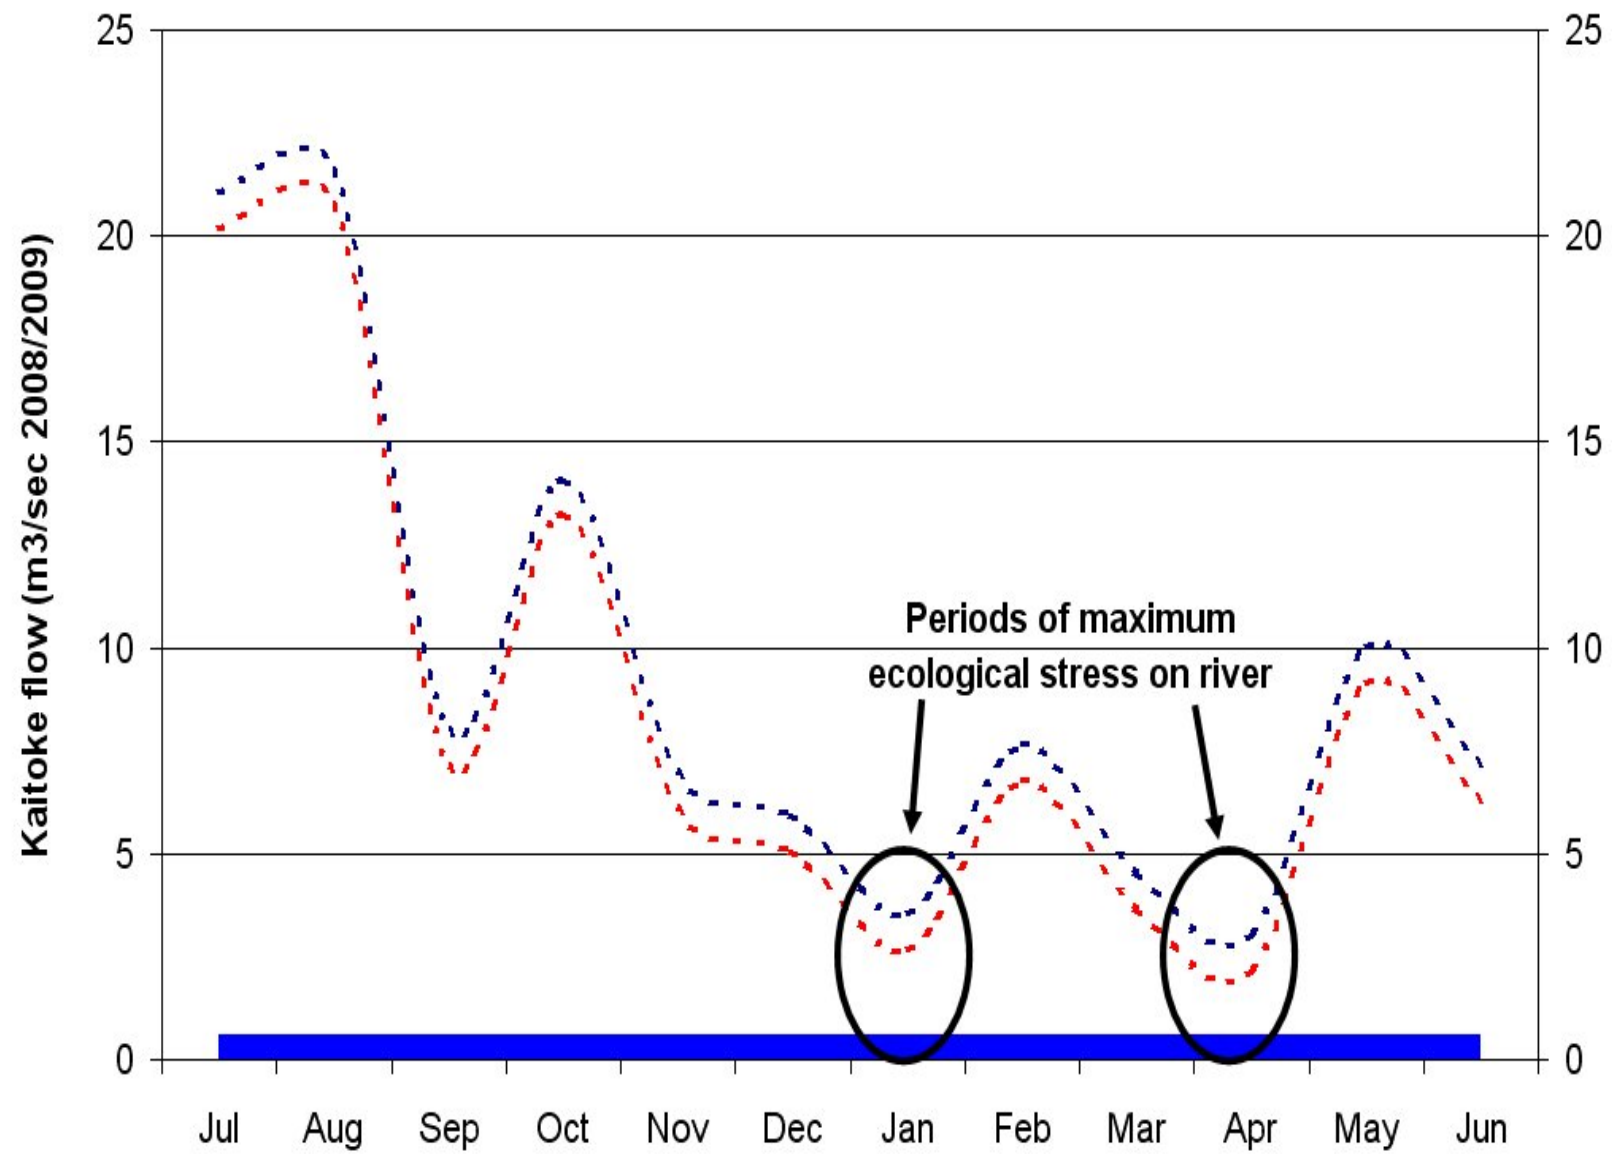

600 litres/ second minimum flow level **- - - 2009 flow**
- - - 2009 flow after average GWRC abstraction

Giving 'value' to water in Wellington

- ✓ Prioritise protection of freshwater ecosystems
- ✓ Build water efficiency into Wellington's households and businesses
- ✓ Engage and educate on water conservation and efficiency issues
- ✓ Integrate planning and research for potable water, stormwater and wastewater services
- ✓ Consider a volumetric water conservation and efficiency levy